

Historic, archived document

Do not assume content reflects current scientific knowledge, policies, or practices.

1
dg 84F
RS

LIBRARY



APR 26 1932
U. S. Department of Agriculture

U. S. DEPARTMENT OF AGRICULTURE

FARMERS' BULLETIN No. 1678

Has been rev.
--see rev.ed.
binders at
end of file.

SAFE USE AND STORAGE OF GASOLINE AND KEROSENE ON THE FARM

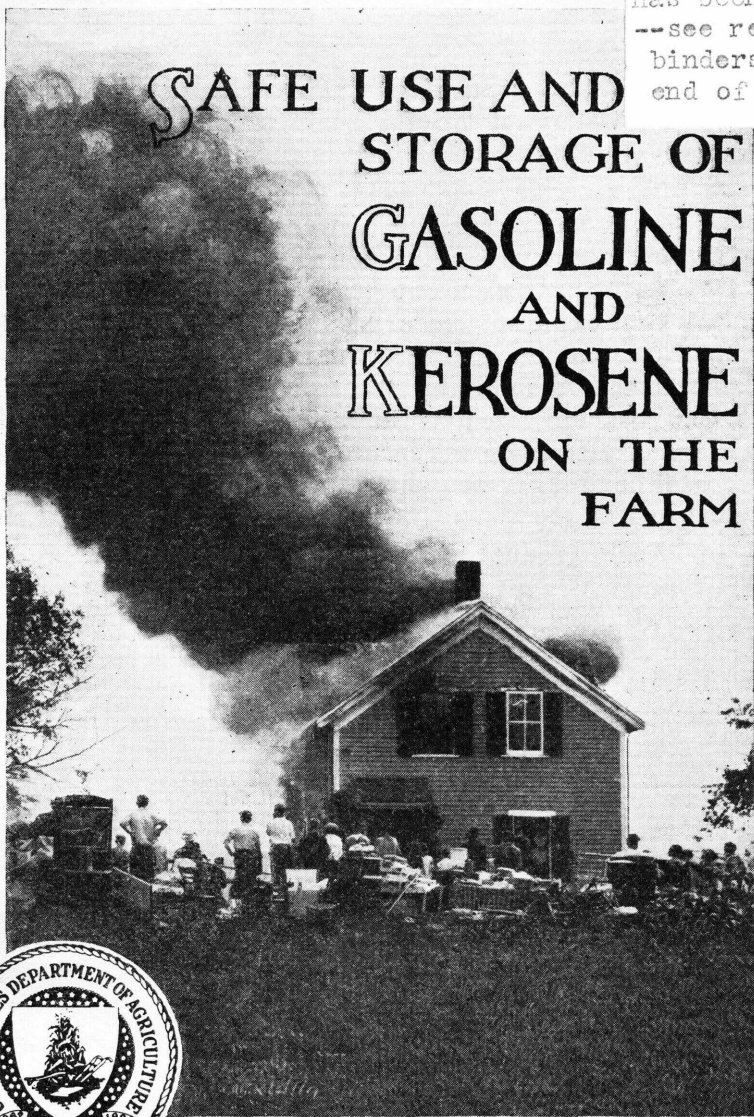

CARELESS USE AND STORAGE OF PETROLEUM and its products cause an annual fire loss of approximately \$7,500,000 on farms of the United States.

Gasoline and kerosene, as well as other flammable liquids, are always potentially dangerous. Lives and property may be reasonably safeguarded against this fire and explosion hazard, however, by the proper storage and the careful handling and use of these liquids. This bulletin points out the most common hazards, and the precautions which should be observed. It also gives information on extinguishing gasoline and kerosene fires.

The United States Department of Agriculture, in an effort to reduce the extensive loss of both life and property as the result of fires on farms, is cooperating with the National Fire Protection Association, with executive offices at 60 Batterymarch Street, Boston, and other organizations and associations interested in fire prevention.

Washington, D. C.

Issued February, 1932

THE SAFE USE AND STORAGE OF GASOLINE AND KEROSENE ON THE FARM¹

Issued by the *Bureaus of Chemistry and Soils, Agricultural Engineering, and Agricultural Economics*, in cooperation with the *National Fire Protection Association*²

CONTENTS

	Page		Page
Farm-fire loss from the careless use of petroleum and its products.....	1	Hazards of fuel-oil burners.....	6
Flammability of gasoline and kerosene.....	2	Proper storage of gasoline and kerosene.....	7
Danger of starting and reviving fires with gasoline or kerosene.....	2	Gasoline.....	7
The safe way to handle oil lamps, heaters, stoves, incubators, brooders, and lanterns.....	3	Placing of tanks.....	8
Hazards of cleaning with gasoline and other volatile liquids.....	4	Construction of tanks.....	9
Hazards of spraying disinfectants.....	4	Venting of tanks.....	9
Hazards of using quick-drying paints and lacquers in the home.....	4	Pumps.....	9
Hazards of gasoline lighting and cooking systems.....	5	Piping.....	9
Hazards of automobiles, trucks, tractors, and stationary engines.....	5	Overhead shelter.....	10
Hazards of pouring gasoline from one container into another.....	6	Kerosene.....	10
		Drawing gasoline and kerosene.....	10
		How to extinguish gasoline and kerosene fires.....	10
		Foam extinguishers.....	10
		Carbon dioxide extinguishers.....	12
		Carbon tetrachloride extinguishers.....	12
		Loaded-stream extinguishers.....	13
		Use of sand, soda and sawdust, and water.....	13

FARM-FIRE LOSS FROM THE CARELESS USE OF PETROLEUM AND ITS PRODUCTS

PETROLEUM AND ITS PRODUCTS rank sixth in order of importance as a cause of fires on farms.³ It is responsible for almost 7½ per cent of the total farm-fire loss⁴ (excluding the loss attributed to unknown causes). In other words the estimated fire loss on farms caused by the careless use and storage of petroleum and its products amounts to \$7,500,000 annually.

Probably several hundred people on farms are killed or seriously burned each year from the careless handling and storage of gasoline and kerosene.

While gasoline and kerosene, as well as other flammable liquids, are always potentially dangerous, lives and property may be reasonably safeguarded against this fire hazard by the proper storage and the careful handling and use of these liquids.

¹ This bulletin was prepared by Harry E. Roethe of the chemical engineering division, Bureau of Chemistry and Soils, chairman of the subcommittee of the farm-fire protection committee on the handling and storage of gasoline and kerosene. The other members of this subcommittee were Clarence Goldsmith, of the National Board of Fire Underwriters, and George F. Lewis, deputy fire marshal of the Province of Ontario.

² David J. Price, the chairman, and Harry E. Roethe, the secretary, both of the Bureau of Chemistry and Soils; M. C. Betts, Bureau of Agricultural Engineering; and V. N. Valgren, Bureau of Agricultural Economics, are representatives of this department on the farm-fire protection committee of the National Fire Protection Association, which assisted in carrying on investigations and in supplying valuable data for this bulletin. The committee membership includes representatives of interested agencies in the United States and Canada.

³ According to statistics of the National Board of Fire Underwriters.

⁴ Estimated by the farm-fire protection committee to be approximately \$100,000,000 annually.

FLAMMABILITY OF GASOLINE AND KEROSENE

All grades of gasoline are highly flammable and dangerous. They always should be treated as such.

Gasoline has been called "liquid dynamite" because of the explosive violence which results from the ignition of gasoline vapor mixed with air in certain proportions. The various grades of gasoline differ somewhat in chemical and physical properties. The better grades are much more hazardous to handle than others. As they are much more volatile, they mix with air in larger proportions and pass into vapor form (evaporate) more rapidly.

Gasoline vapor is heavier than air; consequently it will float along near the ground, like an invisible stream, for considerable distances. In a lean mixture (a little less than 2 per cent) 5 gallons of gasoline would produce 8,000 cubic feet of burnable or mildly explosive gas (gas-air mixture), or enough to fill a room having the dimensions 20 by 40 by 10 feet. If ignited, and if no heat is lost and the products of combustion are at atmospheric pressure, this mixture would expand to eight or ten times the initial volume of air and gas vapor, with destructive results.

As with other gases and vapors, before an explosion of gasoline vapor can occur a definite proportion of air and gasoline vapor must be present. In 100 parts by volume of air and gasoline, an explosion will not take place if there is less than $1\frac{1}{2}$ or more than 6 parts of gasoline vapor.⁵ In other words, the explosive range is between $1\frac{1}{2}$ and about 6 per cent of gasoline vapor. This range of explosibility is narrow as compared with that of many other mixtures of combustible gases and air; nevertheless in the lower limit there is a very small proportion of gasoline vapor, indicating the great importance of not allowing even a little gasoline to be exposed in a room or confined space.

Kerosene (lamp oil or coal oil) is not highly flammable like gasoline. When heated, however, it gives off dangerous vapors which are capable of forming explosive mixtures with air. Generally kerosenes have flash points⁶ above 100° F., whereas the flash points of gasoline will range down to lower than 0° F.

DANGER OF STARTING AND REVIVING FIRES WITH GASOLINE OR KEROSENE

With considerable regularity the press contains news items of lives and property destroyed as a result of an attempt to start or revive a fire in a stove or a furnace with flammable liquids, generally kerosene. (Fig. 1.) This practice is dangerous, but it is followed to an alarming extent. The reason must be either ignorance or the willingness to take a chance.

The hazard of fire from the burning of the liquids themselves is serious, but the hazard of ignition of the explosive gases formed is doubly serious. The safe rule to follow is never try to start or revive a fire with gasoline or kerosene.

⁵ Bureau of Mines, Tech. Paper 115, Inflammability of Mixtures of Gasoline Vapor and Air.

⁶ The temperature at which flammable vapor given off from fuel oil will ignite temporarily, or flash.

THE SAFE WAY TO HANDLE OIL LAMPS, HEATERS, STOVES, INCUBATORS, BROODERS, AND LANTERNS

Kerosene lamps, heaters, stoves, incubators, brooders, and lanterns should be carefully handled. They should never be filled while burning. In extinguishing lighted lamps, lanterns, and heaters turn down the wick a little and put out the flame by blowing over the top of the burner. It is dangerous to blow out the flame from underneath or to turn the wick down very low.

Wicks and burners should be kept clean. Boil the burners occasionally in soda lye or soap. An explosion may result from defective wicks which do not entirely fill the wick tube section of the burner. Such wicks permit free communication between the flame and the space above the oil in the reservoir.

Kerosene lamps should not be made of glass. They should be of metal, with broad, metal bases. Lamp shades should be of material that will not burn. Never place lamps near the edge of a table or near curtains.

Lanterns should be free from leaks, and lighted lanterns when not being carried should be hung on substantial hooks or supports out of the

wind, away from cobwebs and other combustible materials and at a height sufficient to insure protection against damage or disturbance.

Do not place kerosene lamps or lanterns near stoves or in other warm places because the heating of the kerosene in the receptacle will form vapors that will cause "flaring."

Do not carry lighted oil heaters about the house. Children should be cautioned about playing near them or upsetting them.

Brooders should be placed in an isolated location. It is dangerous to operate them in the house or barn. Overheating should be guarded against.

Although the fire hazard from incubators is not considered as great as that from brooders, they should be operated with care, especially when in the home. Guard against overheating. Use brooders and incubators which bear the label of and are listed by the Underwriters' Laboratories.



FIGURE 1.—Never start or revive a fire with gasoline or kerosene

HAZARDS OF CLEANING WITH GASOLINE AND OTHER VOLATILE LIQUIDS

Cleaning with gasoline, benzine, and other flammable, volatile liquids is distinctly hazardous and should not be practiced, especially indoors. During cleaning operations vapors are given off which may form explosive mixtures with the air. All that is needed then to produce an explosion is a source of ignition, such as an open flame from lighted matches, kerosene lamps, stoves and heaters, gas jets, mantles or burners; a lighted cigar, cigarette, or pipe; a metallic spark, an electric spark, or a static spark. Many explosions with loss of life have resulted from the ignition of these vapors by open flames and electric sparks.



FIGURE 2.—Use a nonflammable liquid such as carbon tetrachloride for dry-cleaning at home

Also several serious explosions and fires have resulted from the ignition of gasoline vapors both indoors and outdoors by static sparks caused by the rubbing of fabrics and kid gloves on the hands with the liquid. In performing what they thought the harmless task of washing silk dresses and kid gloves with gasoline, these persons did not realize that they were exposing themselves to a menacing explosion and fire hazard.

If it is necessary to do any "dry-cleaning" at home, a nonflammable liquid such as carbon tetrachloride should be used in small quantities. (Fig. 2.) Carbon tetrachloride in any considerable quantity should be used out of doors as it is toxic (slightly anæsthetic). Persons have been overcome by using only a gallon of it in a closed room.

Other volatile oil solvents, sold under various trade names, with a flash point approximately the same as that of kerosene, are now being used to some extent for dry-cleaning purposes in the home. They should be used out of doors, however, and only in the daytime, well away from flame or sparks that might cause ignition.

HAZARDS OF SPRAYING DISINFECTANTS

Spraying disinfectants in the home for the purpose of killing flies, moths, and ants is now a common practice. Most of these liquids, if not all of them, are flammable. Spraying, therefore, should not be done in the presence of an open flame or a lighted cigar, cigarette, or pipe, or other source of ignition, and the container holding the liquid should be kept closed and away from heat.

HAZARDS OF USING QUICK-DRYING PAINTS AND LACQUERS IN THE HOME

Spraying quick-drying enamels, lacquers, or finishes in the home has created a new and insidious explosion and fire hazard. Pyroxylin lacquers, brushing lacquers containing pyroxylin, and, as a

matter of fact, most materials sold under this designation, contain amyl acetate, alcohol, and similar liquids which are highly flammable.

The vapor formed by these lacquers and finishes is heavier than air and highly flammable. It will fall to the surface of the ground and may be carried considerable distances. If the proper mixture of vapor and air is present as well as a source of ignition, such as an open flame, a lighted pipe, cigar, or cigarette, a static spark, a metallic spark, or an electric spark, an explosion will result. These vapors may even flash back to the user from a flame located at a seemingly great enough distance for safety.

In general, this hazard can be guarded against by adequate ventilation. The application of these quick-drying paints and lacquers either by sprayers operated by hand or by those attached to vacuum cleaners should, therefore, be carried on out of doors whenever possible, so that the vapors will be quickly dissipated and carried away in the open air. If of necessity spraying is carried on indoors, every precaution should be taken to insure that there are no open lights, fires, sparks, or other sources of ignition near by and that the windows and doors are open. Smoking should be strictly prohibited.

HAZARDS OF GASOLINE LIGHTING AND COOKING SYSTEMS

In gasoline lighting and cooking systems many hazards can be introduced by faulty design and construction of equipment, such as corrodible material, improperly made joints, and valves of poor design. Only the best and most reliable types of this equipment should be used, such as those which have been tested and listed by the Underwriters' Laboratories, or other well-recognized authorities. Even then certain inherent hazards are possible. The installation should be in strict accordance with the manufacturer's directions and with the recommendations⁷ of the National Fire Protection Association.

With the operation of this equipment the hazard of explosive vapors is again introduced. The tanks should be filled carefully, and only during the daytime. They should never be filled in the vicinity of an open flame or other sources of ignition.

HAZARDS OF AUTOMOBILES, TRUCKS, TRACTORS, AND STATIONARY ENGINES

Stationary and automotive engines may backfire when started. If this happens in the vicinity of combustible materials or explosive gases and dusts a fire may result. Combustible materials should be kept away from such equipment even when in apparently normal operation because there is always the chance of a fire through an overheated or faulty muffler, hot or burning carbon deposits, and faulty ignition. It is dangerous, therefore, to house or use internal-combustion engines or automotive equipment so driven, in barns and granaries.

⁷ Regulations of the National Board of Fire Underwriters for the Installation, Maintenance, and Use of Gasoline Vapor Gas Machines, Lamps, and Systems as Recommended by the National Fire Protection Association, edition of 1926; and Regulations of the National Board of Fire Underwriters for the Installation and Operation of Compressed Gas Systems Other than Acetylene for Lighting and Heating as Recommended by the National Fire Protection Association, edition of 1927.

Do not start automobile or other gasoline engines in a closed garage or other building. (This precaution does not apply to engines equipped with a fixed exhaust to the outside of the building.) In starting such engines it frequently happens that the mixture is too rich. As a consequence, deadly carbon monoxide (CO) is given off. This gas in very small quantities is fatal to human life. Furthermore, the fact that it is odorless and colorless and can not be detected by the sense of smell and the sense of sight makes it doubly dangerous. Before starting engines in confined spaces always open doors and windows in order to provide ventilation and permit the removal of carbon monoxide.

Cleaning automobiles, tractors, and stationary engines with gasoline is dangerous. The vapor produced presents an explosion hazard, the source of ignition readily being supplied by an open flame, cigar or cigarette coals, static electricity, the ignition system of the engine, or a spark caused by striking two pieces of metal together.

HAZARDS OF POURING GASOLINE FROM ONE CONTAINER INTO ANOTHER

Dangerous vapors are given off when gasoline is poured from one container into another or when the liquid is exposed to the air, thus forming an explosive mixture of vapor and air which may be ignited very easily. Consequently such pouring should not be done near open flames or lights, or near engines and motors while they are running. Smoking, and electric and metallic sparks also are sources of ignition that should be guarded against.

Another source of ignition is static electricity. Static electricity can be generated by gasoline in a number of ways. It is generated, for example, by gasoline flowing through either a metal pipe or a rubber hose, by gasoline being poured from one container into another or being filtered through chamois, and by gasoline swishing about inside a tank or tank wagon. Unless the containers or other equipment are grounded the static charge accumulates and eventually escapes to the ground by jumping across or bridging near-by points or areas. A spark or series of sparks is thus produced, and an explosion of the vapor may result. To prevent such an occurrence the containers or other equipment should be grounded or be in contact with the ground.

In pouring gasoline from a can or a drum into another container with a funnel, for example, a simple expedient is to keep the mouth of the container from which the gasoline is being poured in contact with the funnel, and the funnel in turn in direct contact with the receptacle being filled, the latter resting on the ground. When filling the tank of the tractor, automobile, or gas engine it is a simple matter to keep the metal nozzle of the hose in contact with the mouth of the tank, thus preventing the passage of a static spark. An additional precaution is to touch the filling nozzle to some metal part of the automobile or tractor before placing it in the mouth of the tank.

HAZARDS OF FUEL-OIL BURNERS

Although on farms the use of oil for heating the home is limited, the subject is of sufficient importance to be touched upon in this bulletin.

As with heating apparatus of other kinds, a fire hazard is associated with domestic oil burners. Fire records in the urban districts

indicate that the greatest number of fires with property-damage loss attributed to domestic oil burners are caused by the failure of automatic shut-off valves to function and thus stop the supply of oil; loose connections and leaking pipes; back-firing; defective burners; and careless operation.

It is of great importance, therefore, that only domestic oil burners be selected or used which have been tested by and bear the label of the Underwriters' Laboratories. This label is assurance to the buyer or user that the oil burner bearing the label has been safeguarded to a reasonable degree and is so made that it may readily be installed in accordance with the recommendations of the National Fire Protection Association.

Oil-burning systems involve the installation of tanks, piping, the burner proper, and, in some cases, electrical wiring. In handling all this equipment, the recommendations of the National Fire Protection Association⁸ and the National Electrical Code should be followed. The installation should be made only by competent, reliable workmen, strict attention being paid to the manufacturer's instructions. The principal object to keep in mind when installing tanks and piping for an oil burner is the complete delivery of the oil to the burner.

The equipment, once installed, should receive adequate and intelligent attention. When in operation, the oil burner should be looked over at least once a day, and preferably oftener. Care should be taken to see that automatic devices or provisions to prevent flooding of the burner are always in good working order.

Oils used in domestic oil burners should have a flash point of not less than 100° F. or the local legal minimum.

PROPER STORAGE OF GASOLINE AND KEROSENE⁹

With the more or less general use of tractors, stationary engines, and automobiles on farms, the hazard incident to the storage of flammable liquids has become serious. It is very important that the farmer who uses these liquids on his farm give serious consideration to their storage. The following suggestions are offered.

GASOLINE

Gasoline should never be stored or handled in open containers in any building. All containers for gasoline should be red, and the word **GASOLINE** should be painted on them in a conspicuous manner.

In buildings (except a special storage room or fire-resistive building) gasoline should be stored in a sealed container or safety can (fig. 3), the total quantity thus stored not to exceed 1 gallon.

Outside buildings, gasoline should be stored in substantially constructed steel drums (fig. 4) of not more than 60 gallons capacity, equipped with a pump, the drum or drums being at least 75 feet from the nearest building; or in an approved underground tank (fig. 5) equipped with a pump, the tank being at least 10 feet from the nearest building. Such tanks may be had in capacities ranging upward from 110 gallons.

⁸ Regulations of the National Board of Fire Underwriters for the Installation of Oil-Burning Equipments and for the Storage and Use of Oil Fuels in Connection Therewith as recommended by the National Fire Protection Association, edition of 1928.

⁹ The material on the placing, construction, and venting of tanks, pumps, and piping was taken from Suggested Ordinance Regulating the Use, Handling, Storage, and Sale of Flammable Liquids and the Products Thereof. Adopted 1926, published by the National Fire Protection Association.

PLACING OF TANKS

The top of an underground tank should not be less than 2 feet below the surface of the ground, and should be below the level of



FIGURE 3.—Safety can for storing small quantities of gasoline

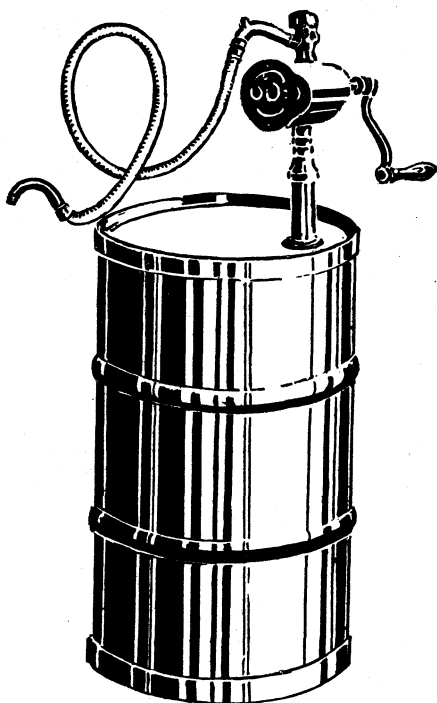


FIGURE 4.—Steel drum for storing gasoline

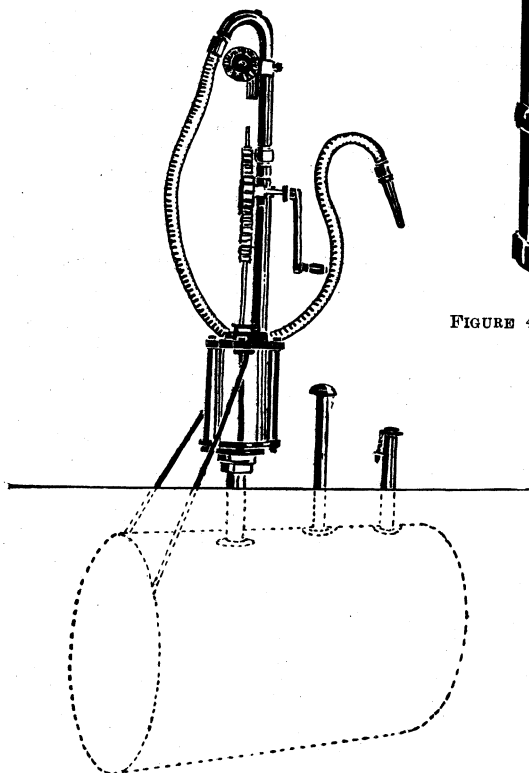


FIGURE 5.—Underground tank and pump for storing gasoline

any piping to which the tank may be connected. Instead of being buried 2 feet underground, the tank may be buried under 12 inches of earth, and a cover of reinforced concrete at least 6 inches in thickness provided. This cover should extend at least 1 foot beyond the outline of the tank in all directions and should be placed on a firm, well-tamped earth foundation.

A tank that can not be entirely buried should be covered over with earth to a depth of at least 2 feet, with a slope on all sides not steeper than $1\frac{1}{2}$ feet horizontal to 1 foot vertical.

CONSTRUCTION OF TANKS

Tanks, including top, sides, and bottom, should be constructed of open-hearth steel or wrought iron of a thickness not less than that specified in Table 1. No seconds should be used. All material lighter than No. 7 U. S. Standard Gage should be galvanized.

TABLE 1.—*Thickness and weight of metal for gasoline and kerosene tanks*

Capacity (gallons)	Minimum thickness of material	Pounds per square foot
	<i>Gage</i> ¹	<i>Pounds</i>
1 to 285.....	16	2.50
286 to 560.....	14	3.125
561 to 1,100.....	12	4.375
1,101 to 4,000.....	7	7.50

¹ U. S. Standard.

Tanks should be riveted, welded, or brazed, and should be soldered, caulked, or otherwise made tight. They should also be thoroughly coated on the outside with tar, asphaltum, or other suitable rust-resisting material. All pipe connections should be made through flanges or metal reinforcements securely riveted, welded, or bolted to the tank, and should be absolutely tight. All openings should be gas-tight, except the breather vent, which should be screened.

VENTING OF TANKS

An open galvanized-iron vent pipe arranged for proper draining, or an automatically operated vent, should be provided for every tank that may contain flammable vapor. The lower end of the vent pipe should not extend through the top into the tank for a distance of more than 1 inch.

Vent openings should be screened (preferably by 40 by 40 but not less than 30 by 30 noncorrodible wire mesh or its equivalent). The area should be sufficient to permit escape of air or vapor during the filling operation. Vent pipes should be provided with weatherproof hoods.

PUMPS

Flammable liquids should be drawn from tanks by pumps so constructed as to prevent leaking or splashing.

PIPING

All piping used in systems for flammable liquids should be of the standard full-weight wrought-iron, steel, or brass type (for working pressures less than 100 pounds per square inch), with suitable brass or galvanized malleable-iron or steel fittings.

Outside piping within 5 feet of the ground level should be protected against any mechanical injury. Inside piping should be rigidly supported.

All pipes carrying flammable liquids should pitch toward the tanks without any traps or pockets and should enter tanks at the top.

No rubber or other packings, and no flanges should be used. If unions are used, at least one face should be of brass, with close-fitting conical joints. Litharge and glycerin, shellac, or other suitable material should be used on pipe joints.

OVERHEAD SHELTER

Drums and tanks may be provided with a simple, inexpensive, overhead shelter to afford protection against the weather. Such a shelter will not give opportunity for the accumulation of gasoline vapor, as would an inclosed structure.

KEROSENE

Kerosene should not be stored or handled in open containers in any building.

Only moderate quantities of kerosene should be stored in buildings and then only in closed containers or substantial drums equipped with a pump. The containers should be kept at a safe distance from furnaces or other heating appliances and from flammable rubbish.

Large quantities of kerosene should be stored outside buildings in substantial drums equipped with a pump or in an underground tank equipped with a pump. (See details regarding construction and placing of underground tanks and appurtenances under Gasoline, p. 8 to 10.)

It is important that cans, barrels, and drums holding kerosene be kept clean and that the word KEROSENE be painted on them in a conspicuous manner.

DRAWING GASOLINE AND KEROSENE

Gasoline and kerosene should never be drawn or handled in the presence of open flames or fire. If it is necessary to do this at night, light should be afforded by electric flashlight or incandescent electric lamps installed in compliance with the National Electrical Code.

Drums for gasoline and kerosene should be provided with caps, plugs, or bungs, and these should always be replaced immediately after the container is emptied.

Smoking or the use of matches should not be permitted where vapors of flammable liquids are present or are likely to be formed.

HOW TO EXTINGUISH GASOLINE AND KEROSENE FIRES¹⁰

Fires are commonly put out in two ways: (1) By cooling the burning materials to below their burning temperature; and (2) by smothering the fire, thus depriving it of the air (oxygen) necessary to support combustion.

Gasoline and kerosene fires are best extinguished by smothering, as by a foam or gas. The following appliances are recommended for fighting such fires: Foam extinguishers, carbon dioxide extinguishers, carbon tetrachloride extinguishers, loaded stream extinguishers.

It is important that only first-aid fire appliances which have been tested by and bear the label of the Underwriters' Laboratories be selected or used, and that they be properly operated and maintained.

FOAM EXTINGUISHERS

One 2½-gallon foam extinguisher (fig. 6) is considered a unit of first-aid fire protection for gasoline and kerosene fires.

When an extinguisher of this type is inverted two solutions contained in it mix and react, producing a foam under sufficient pres-

¹⁰ The material on this subject is based on the pamphlet *How to Put Out a Fire*, published by the National Fire Protection Association; and *Regulations of the National Board of Fire Underwriters for the Installation, Maintenance, and Use of First Aid Fire Appliances* as recommended by the National Fire Protection Association, effective March 1, 1930.

sure to furnish a forceful stream. One solution is sodium bicarbonate and a foam-producing agent, and the other is a water solution of aluminum sulphate. About 20 gallons of foam are produced by the 2½-gallon extinguisher.

The foam extinguishes a fire by both the cooling and smothering effects. Containing a liberal quantity of water, it has considerable cooling effect. The foam itself smothers the fire by clinging to the

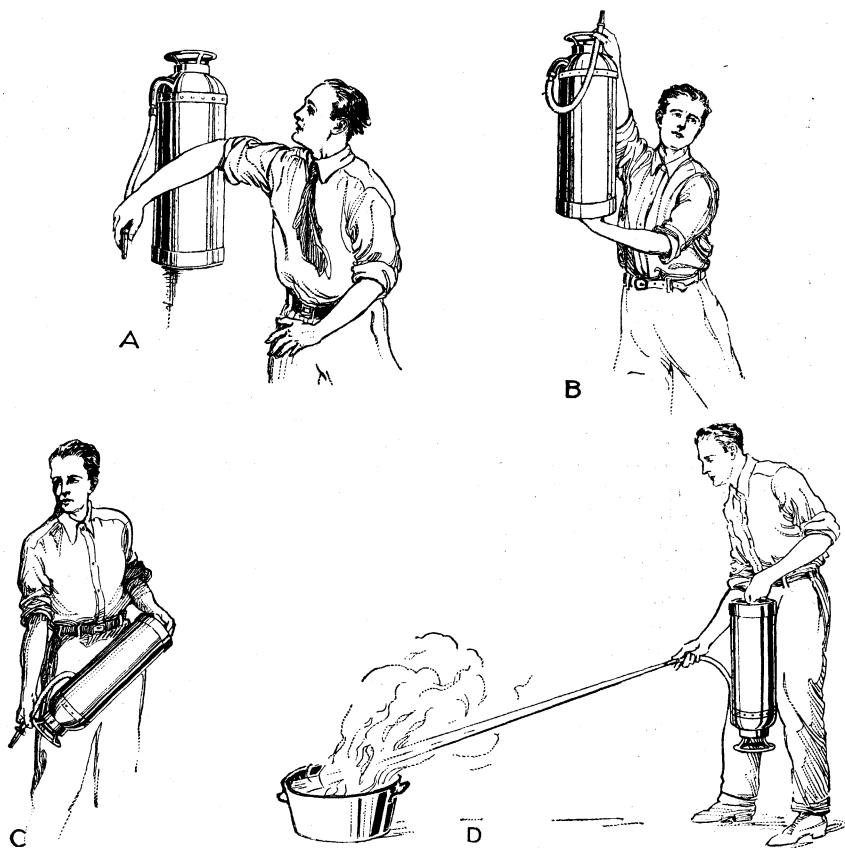


FIGURE 6.—A, It is important that the hose be held between the thumb and the index finger of the right hand when bringing the extinguisher into use. B, Grasp the ring top with the fingers of the right hand and the bottom with the left hand, then lift the extinguisher off the hanger hook and carry it to the fire. C, The extinguisher can now be easily inverted by grasping the bottom handle with the left hand. When the extinguisher is approximately in the position shown, the fingers of the right hand should release the ring top, but should continue to hold the hose. The extinguisher, upside down, the left hand holding the bottom handle, is now in full operation. D, The stream should be directed against the inside of the opposite wall of the tank, above the level of the burning liquid. The operator should walk around the fire if possible, and if the fire is on the floor he should stand back and allow the foam to fall on the fire without much force, thereby preventing the spread of the flames

burning materials and excluding air (oxygen). This extinguisher is effective on fires in small quantities of flammable liquids in vats or other open vessels, or on floors, where the foam may be retained as a blanket on the burning material.

Although the stream is usually most effective when directed from a distance, it may also be used close to the fire. In case of necessity it can be directed effectively from a distance as great as 30 to 40 feet.

CARBON DIOXIDE EXTINGUISHERS

There are two principal sizes in the hand extinguishers of the carbon dioxide type (fig. 7), one containing approximately $7\frac{1}{2}$ pounds of carbon dioxide and the other 15 pounds. One 15-pound extinguisher or two $7\frac{1}{2}$ -pound extinguishers are considered a unit of first-aid fire protection for gasoline and kerosene fires.

From two-thirds to three-fourths of the gas contents in the cylinder is liquefied by pressure. Because of rapid expansion and high heat capacity this gas, when released, instantly freezes into a dry carbonic snow, which is intensely cold, -110° F. It does not melt, but evaporates directly into a gas. The fire is extinguished by the blanketing effect of the carbonic gas. The carbon dioxide is a non-conductor of electricity.

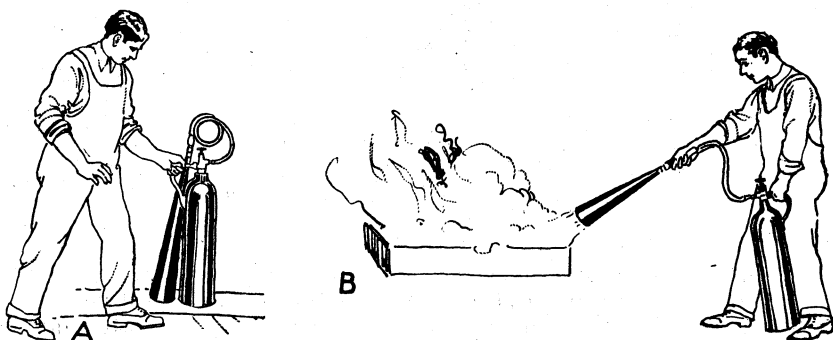


FIGURE 7.—A, The extinguisher is removed by grasping the handle with the left hand. It should be carried to the fire by means of the handle. To release the gas the valve is opened by turning it counterclockwise. B, Direct the discharge as close to the fire as possible, applying it first at the edge and bottom of the fire and progressing forward and upward, moving the discharge horn slowly from side to side. Continue the discharge even after the fire has been extinguished in order to cool the liquid and prevent possible refashing.

This type of extinguisher is effective on fires in small quantities of flammable liquids in vats or other open vessels, or on floors, where the blanketing effect of the extinguishing gas is of value. It has a maximum range of about 8 feet, but best results are obtained by directing the discharge as close to the fire as possible. This extinguisher does not need protection against freezing.

CARBON TETRACHLORIDE EXTINGUISHERS

Two 1-quart or two $1\frac{1}{2}$ -quart carbon tetrachloride extinguishers (fig. 8) ordinarily constitute a unit of first-aid fire protection. Two extinguishers of the 1-gallon size are suggested for more effectively fighting gasoline and kerosene fires. By means of the hand pump a stream of carbon tetrachloride is expelled on the fire. The heat of the fire causes this liquid to vaporize, producing an incombustible, heavier-than-air gas, which forms a blanket over the burning material, cutting off the supply of air (oxygen) necessary to support combustion. Carbon tetrachloride is a nonconductor of electricity.

This type of extinguisher is effective on fires in small quantities of flammable liquids in vats or other open vessels, or on floors, where the gas formed by the heating of the extinguishing liquid may be retained as a blanket on the burning material. Although the stream is usually most effective when used close to the fire, in case of necessity it can be directed from a distance of 20 feet.

The carbon tetrachloride extinguisher is compact and needs no protection against freezing. Care should be taken to ventilate small rooms and confined spaces immediately after using this extinguisher.



FIGURE 8.—A, Remove the extinguisher from the wall bracket by grasping the handle and pulling outward. B, On the way to the fire unlock the handle by turning. If the device is of the air-pump type, hold a finger over the nozzle and pump up the pressure. C, Direct the stream at the base of the flames and work around the fire rapidly. If the fire is in an open container or tank, direct the stream against the inside of the opposite wall above the level of the burning liquid.

LOADED-STREAM EXTINGUISHERS

Two 1¾-gallon extinguishers of the loaded-stream type (fig. 9) are considered a unit of first-aid fire protection for gasoline and kerosene fires. This extinguisher is effective on fires in small quantities of flammable liquids in vats or other open vessels, or on floors. The chemicals used are a special acid contained in a sealed bottle, and a special antifreeze solution containing certain alkali metal salts with which the acid will react.

When the extinguisher is inverted and bumped on the ground the acid reacts with the antifreeze solution, generating a gas which expels the contents through the hose. Although the stream is most effective when used close to the fire, in case of necessity it can be directed effectively from a distance of 30 to 40 feet.

This type of extinguisher does not need to be protected against freezing as it employs an extinguishing liquid having a freezing point of -40° F.

USE OF SAND, SODA AND SAWDUST, AND WATER

SAND

Sand is useful on gasoline and kerosene fires where the smothering effect can be utilized, as on small quantities of burning flammable liquids on a wooden floor. Obviously it has no effect in extinguishing flammable liquid fires in open vessels.

Five 12-quart pails filled with dry, clean sand, and equipped with scoops, or a 4-bushel bin filled with sand, with two or more shovels, make up a unit of first-aid fire protection.

Sand pails are not intended to be used alone, but in connection with other extinguishers.

SODA AND SAWDUST

Soda and sawdust are for use only on fires in heavy flammable liquids in open vessels, where the mixture may be spread as a blanket

on the fire. It should be supplemented with other first-aid fire protection.

A substantial galvanized iron or steel bin ($1\frac{1}{2}$ by $1\frac{1}{2}$ feet and $3\frac{1}{2}$ feet high with reinforced edges and sides tapered downward) of 8 bushels capacity and provided with two or more scoop shovels, constitutes a unit of first-aid fire protection. Clean, dry sawdust, evenly mixed with sodium bicarbonate in the proportion of 10 pounds of soda to 1 bushel of sawdust, is the extinguishing agent.

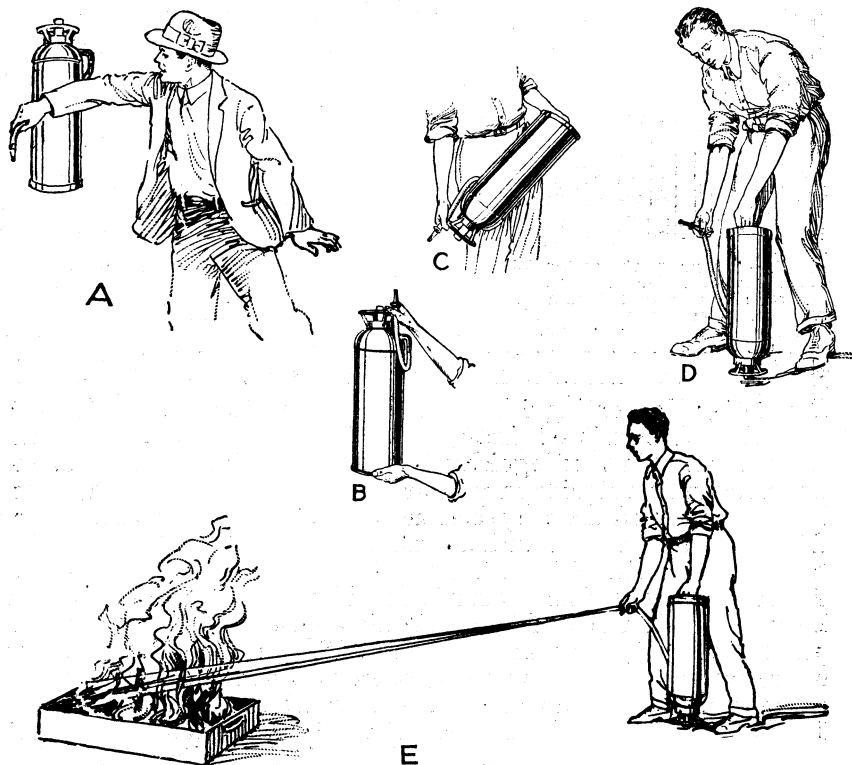


FIGURE 9.—A, The hose should be held between the thumb and the index finger of the right hand when bringing the extinguisher into use. B, Grasp the ring top with the fingers of the right hand and the bottom with the left hand. Then lift the extinguisher off the hanger hook and carry it to the fire. C, Invert the extinguisher by grasping the bottom handle with the left hand, continuing to hold the hose and the ring top with the right hand. D, With the extinguisher in an inverted position bump it on the floor or other hard surface, thus pressing in the plunger pin in the cap. E, Direct the stream against the inside of the opposite wall of the container above the level of the burning liquid. Walk around the fire if possible. If the fire is on the floor direct the stream at the base of the flames. Follow the flames with the stream and cover as much of the burning area as possible.

WATER

Water should not be used to fight gasoline and kerosene fires. In fact, the use of water will make control of the fire more difficult, as it may wash the burning liquid about and thus scatter the fire over a larger area.

U. S. GOVERNMENT PRINTING OFFICE: 1932